

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30
---	---	---	---	---	---	---	---	---	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----

UNIDAD EXTERIOR
UNITE EXTERIEUR
OUTDOOR UNIT
AUSSENGERÄT

INTERCONEXION CUADROS ELECTRICOS
ARMOIRE ELECTRIQUE RACCORDEMENTS
ELECTRIC PANEL INTERCONEXION
ZUSAMMENSCHALTUNG VON ELEKTRISCHEN SCHALTAFELN

OPCIONALES / OPTION / OPTIONAL

A - ARRANCADOR PROGRESIVO
DEMARREUR PROGRESSIF
PROGRESIVE STARTER
SOFTSTARTER

B - RESISTENCIAS ELECTRICAS
BATTERIES ELECTRIQUES
ELECTRIC COIL
ELEKTRISCHES HEIZREGISTER

C - DETECTOR FILTRO SUCIO
ENCRASSEMENT FILTRES
FILTER CLOGGING
MELDER FILTERZUSETZUNG

D - Sonda de Retorno
SONDE DE REPRIS
RETURN SENSOR
RÜCKLAUF FÜHLER

E - MANDO PRIVADO LOCAL
COMMANDE PRIVÉ LOCAL
LOCAL PRIVATE CONTROL
LOKALE EINZELGERÄTSTEUERUNG

F - FREECOOLING TERMICO
FREECOOLING THERMIQUE
THERMAL FREECOOLING
THERMISCHES FREE-COOLING

H - Sonda Temp. de Ambiente
SONDE TEMP. D'AMBIANCE
AMBIENT TEMP. SENSOR
TEMPERATURFÜHLER RAUMLUFT

J - CONTROL CAUDAL DE AIRE
CONTROLE DEBIT D'AIR
AIR FLOW CONTROL
LUFTMENGENREGELUNG

M - VENTILADOR RETORNO CENTRIFUGO
VENTILATEUR DE REPRISE CENTRIFUGE
RETURN CENTRIFUGAL FAN
RÜCKLUFTRADIALVENTILATOR

XI - VENTILADOR INTERIOR CENTRIFUGO
VENTILATEUR INTERNAL CENTRIFUGE
INTERNAL CENTRIFUGAL CENTRIFUGAL
INTERNER CENTRIFUGALVENTILATOR

AA - ALIMENTACION CON NEUTRO
ALIMENTATION AVEC NEUTRE
POWER SUPPLY WITH NEUTRAL
STROMVERSORGUNG MIT NEUTRALLEITER

AB - ALIMENTACION SIN NEUTRO
ALIMENTATION SANS NEUTRE
POWER SUPPLY WITHOUT NEUTRAL
STROMVERSORGUNG OHNE NEUTRALLEITER

AC - VENTILADOR EXTERIOR ELECTRONICO
VENTILATEUR EXTERIEUR ELECTRONIQUES
ELECTRONIC OUTDOOR FAN
EXTERNER ELEKTRONISCHER VENTILATOR

AF - RELE DE CONTROL DE FASES ALTA GAMA
RELAIS CONTROLE PHASES HAUTE GAMME
HIGH RANGE PHASE CONTROL RELAY
PHASENRELAIS HOHE REICHWEITE

UNIDAD EXTERIOR
UNITE EXTERIEUR
OUTDOOR UNIT
AUSSENGERÄT

UNIDAD INTERIOR
UNITE INTERIEUR
INDOOR UNIT
INNENGERÄT

CAJON MEZCLA
CAISSON MELANGE
MIXING BOX
MISCHKASTEN

CAJON RETORNO
CAISSON REPRIS
RETURN BOX
RÜCKFÜHRHEIT

OPTION B

OPTION F

OPTION D

OPTION H-I

OPTION F

OPTION C

OPTION J/B

OPTION M

MODIFICADO POR: MODIFIÉ PAR: MODIFIED BY:	S.R.J.	FECHA: DATE: DATE:	22/01/2018	SERIE :	ISC	MODELO: MODELE:	0182 -	BOMBA DE CALOR AIRE-AIRE PARTIDA. UNIDAD EXTERIOR VENTILADOR HELICOIDAL. REGULACION microPC SMALL	I COMPRESOR/I CIRCUITO I COMPRESSEUR/I CIRCUIT I COMPRESSOR/I CIRCUIT
MODIFICACION: MODIFICATION:	-	V° B°				NP:	06C018283-01	POMPE A CHALEUR AIR-AIR TYPE SPLIT-SYSTEM. UNITE EXTERIEURE. VENTILATEUR HELICOIDALE. REGULATION microPC SMALL	PAGINA PAGE
SUSTITUYE A: REPLACE: TAKE:	-	SUSTITUIDO POR: REPLACÉ PAR: TAKE BY:	-			NF:	-	AIR TO AIR HEAT PUMP SPLIT-SYSTEM. OUTDOOR UNIT HELICOIDAL FAN. microPC SMALL CONTROL	400/3/50

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30
CONEXIONES FABRICA RACCORDMENTS USINE FACTORY CONNECTION WERKSEITIGER ANSCHLUSS						CONEXIONES CLIENTE RACCORDMENTS CLIENT CONNECTED BY CUSTOMER BAUSEITIGER ANSCHLUSS						CONEXIONES FABRICA RACCORDMENTS USINE FACTORY CONNECTION WERKSEITIGER ANSCHLUSS						CONEXIONES CLIENTE RACCORDMENTS CLIENT CONNECTED BY CUSTOMER BAUSEITIGER ANSCHLUSS											
LINEA/LIGNE/PHASE 230 V....						MANDO ON/OFF REMOTO COMMANDE ON/OFF A DISTANCE CONTROL ON/OFF REMOTE EIN-/AUSSCHALTUNG PER FERNBEDIENUNG						OPTION J CONTROL CAUDAL DE AIRE CONTROLE DEBIT D'AIR AIR FLOW CONTROL LUFTMENGENREGELUNG						ON/OFF RESISTENCIAS ELECTRICAS ON/OFF BATTERIES ELECTRIQUES ON/OFF ELECTRIC COIL						SEGUIDADES RESITENCIAS ELECTRICAS SECURITE BATTERIES ELECTRIQUES EELCTRIC COIL SAFETY					
NEUTRO/NEUTRE/NEUTRAL 230 V						CONEXION Sonda T MEZCLA RACCORDMENT SONDE T MELANGE CONNECTION EXTERNAL T MIXING ANSCHLUSS TEMPERATURFÜHLER MISCHLUFT						OPTION F						53						54					
						CONEXION Sonda TEMP. IMPULSION RACCORDMENT SONDE TEMP. SOUFFLAGE CONNECTION DISCHARGE TEMP. SENSOR ANSCHLUSS TEMPERATURFÜHLER ABLUFT						OPTION D OPTION H						55						56					
						CONEXION Sonda TEMP. RETORNO/AMBIENTE RACCORDMENT SONDE TEMP. REPRIS/ D'AMBIANCE CONNECTION RETURN/AMBIENT TEMP. SENSOR ANSCHLUSS TEMPERATURFÜHLER RÜCKLUFT/RAUMTEMPERATURFÜHLER						OPTION AB OPTION M						65						66					
						SEÑAL DE ALARMA 230Vac SIGNAL D'ALARME 230Vac (max. 250 VA) ALARM SIGNAL 230Vac						ACT. VENT. INTERIOR ACT. VENT. INTERIEUR.... ACT. INDOOR FAN						68						...ON/OFF					
LINEA/LIGNE/PHASE 230 V....						CONEXIONES TERMOSTATO mAT RACCORDMENT THERMOSTAT mAT CONNECTION THERMOSTAT mAT ANSCHLUSS THERMOSTAT mAT						VENTILADOR INTERIOR VENTILATEUR INTERIEURE INTERNAL FAN INTERNER VENTILATOR						80						81					
NEUTRO/NEUTRE/NEUTRAL 230 V												COMUNICACION RS485 VEI						83						84					
NEUTRO/NEUTRE/NEUTRAL 24 V						CONEXION SERVOMOTOR RACCORDMENT SERVOMOTEUR CONNECTION SERVOENGINE ANSCHLUSS SERVOMOTOR						VENTILADOR EXTERIOR I VENTILATEUR EXTERIEURE EXTERNAL FAN EXTERNER VENTILATOR						86						87					
LINEA/LIGNE/PHASE 24 V....												PROTECCIONES/PROTECTIONS SCHUTZVORRICHTUNGEN...						T						S					
SEÑAL/SIGNAL 0...10 VDC												OPTION AC						OPTION B											
OPTION C																													
DETECTOR FILTRO SUCIO ENCRASSEMENT FILTRES FILTER CLOGGING MELDER FILTERZUSETZUNG																													
COMUN PROTECCIONES COMMUN DES PROTECTIONS...																													
PROTECTION COMMOM SCHUTZ-GEMEINSAME																													

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30
---	---	---	---	---	---	---	---	---	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----

INTERCONEXION CUADROS ELECTRICOS POR EL CLIENTE / ARMOIRE ELECTRIQUE RACCORDEMENTS PAR CLIENT

ELECTRIC PANEL INTERCONEXION BY CUSTOMER / ZUSAMMENSCHALTUNG VON ELEKTRISCHEN SCHALTТАFELN

UNIDAD EXTERIOR

UNITE EXTERIEURE

OUTDOOR UNIT

AUSSENGERÄT

UNIDAD INTERIOR

UNITE INTERIEURE

INDOOR UNIT

INNENGERÄT

CAJON MEZCLA

CAISSON MELANGE

MIXING BOX

MISCHKASTEN



CAJON RETORNO

CAISSON REPRIS



RETURN BOX

RÜCKFÜHREINHEIT

(CONEXION EN OBRA)

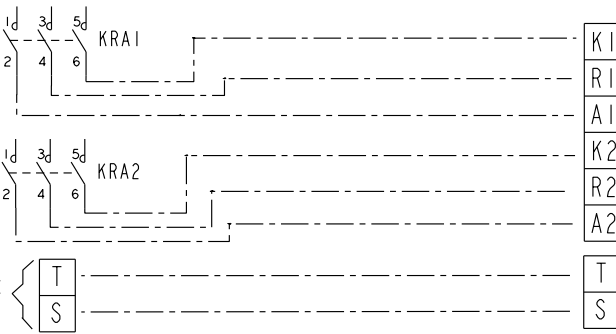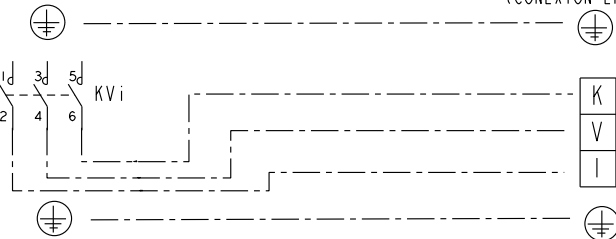

OPTION B

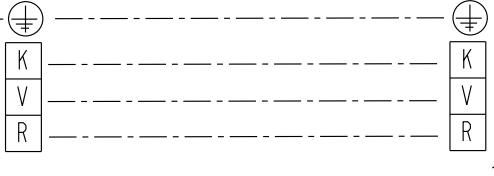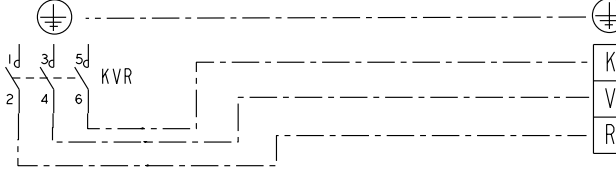

OPTION M

NEUTRO/NEUTRE/NEUTRAL.....

2

2

2

2

OPTION F

CONEXION SONDA T MEZCLA

RACCORDEMENT SONDE T MELANGE

CONNECTION EXTERNAL T MIXING

ANSCHLUSS TEMPERATURFÜHLER MISCHLUFT

5

5

5

6

6


6




OPTION F

MODICADO POR: MODIFIÉ PAR: MODIFIED BY:	S.R.J.	FECHA: DATE: DATE:	22/01/2018	SERIE :	ISC	MODELO: MODELE:	0182 -	BOMBA DE CALOR AIRE-AIRE PARTIDA. UNIDAD EXTERIOR VENTILADOR HELICOIDAL. REGULACION microPC SMALL	I COMPRESOR/I CIRCUITO I COMPRESSEUR/I CIRCUIT I COMPRESSOR/I CIRCUIT
MODIFICATION: MODIFICATION:	-			Vº Bº		NP:	06C018283-01	POMPE A CHALEUR AIR-AIR TYPE SPLIT-SYSTEM. UNITE EXTERIEURE. VENTILATEUR HELICOIDALE. REGULATION microPC SMALL	PAGINA PAGE
SUSTITUYE A: REPLACE: TAKE:	-	SUSTITUIDO POR: REPLACÉ PAR: TAKE BY:	-			NF:	-	AIR TO AIR HEAT PUMP SPLIT-SYSTEM. OUTDOOR UNIT HELICOIDAL FAN. microPC SMALL CONTROL	3/14
									TENSION VOLTAGE
									400/3/50



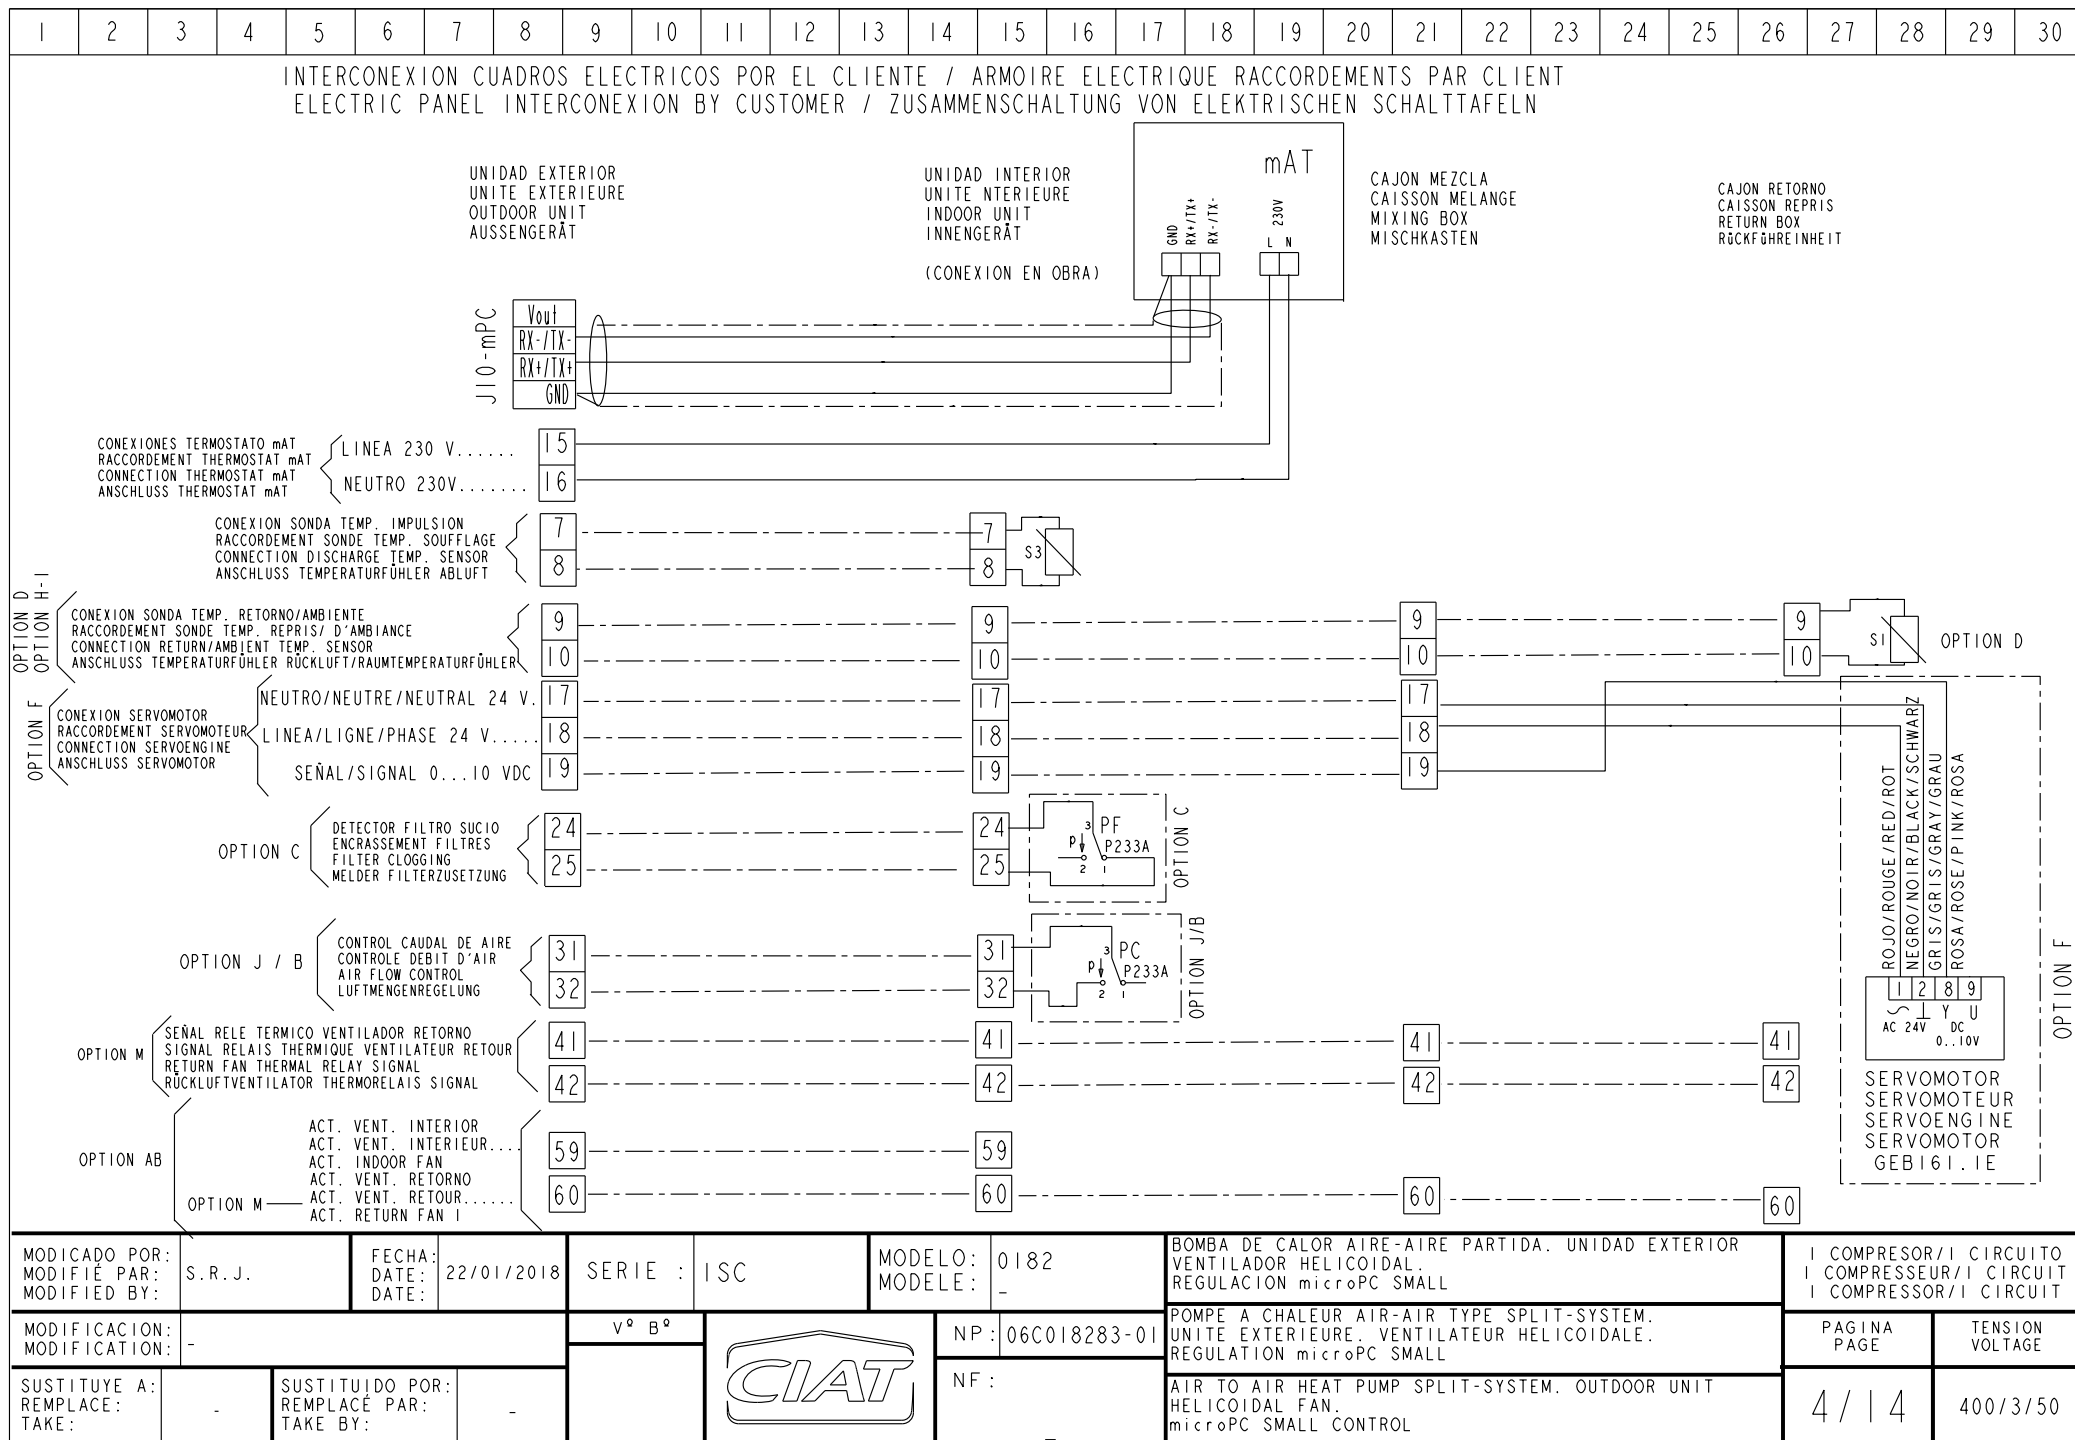


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30
---	---	---	---	---	---	---	---	---	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----

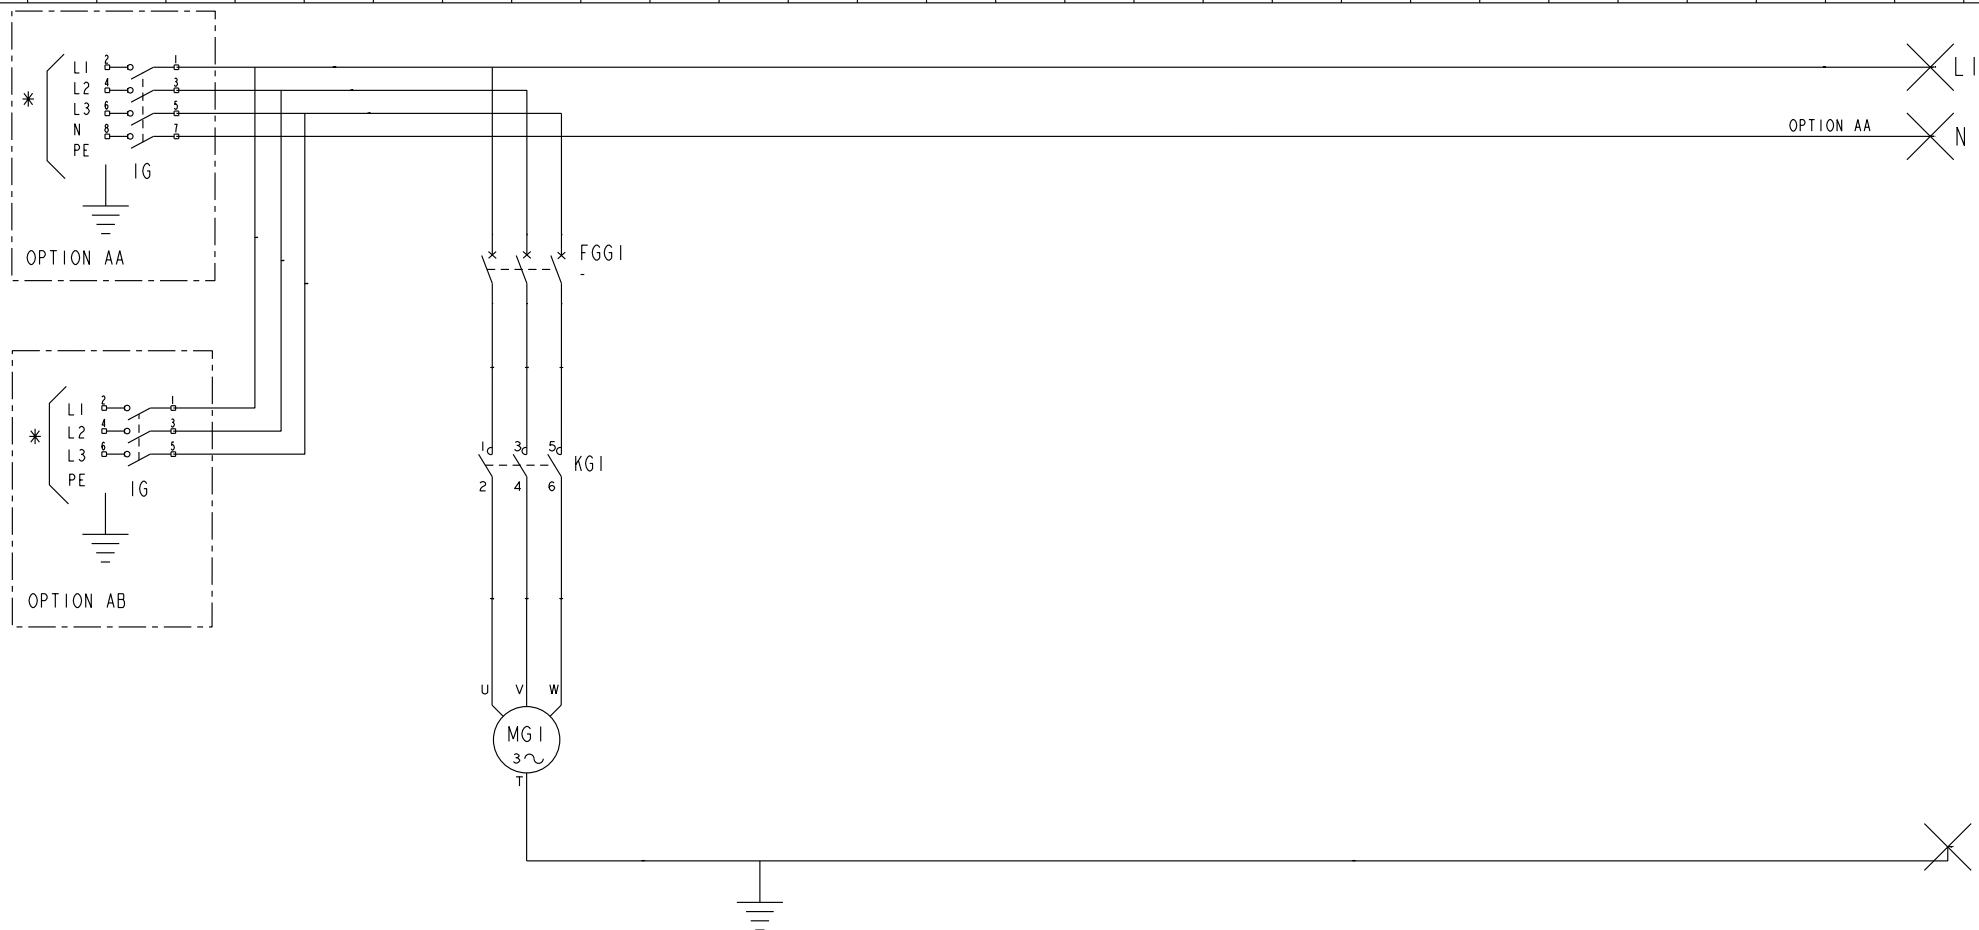


CONEXION DE LA ALIMENTACION EN EL INTERRUPTOR GENERAL
 * RACCORDER L'ALIMENTATION SUR L'INTERRUPTEUR SECTIONNEUR GENERAL
 CONNECTING SUPPLY IN MAIN SWITCH ISOLATOR
 ANSCHLUSS DES NETZTEILS AN DER HAUPTSCHALTER

MODIFICADO POR: MODIFIE PAR: MODIFIED BY:	S.R.J.	FECHA: DATE: DATE:	22/01/2018	SERIE :	ISC	MODELO: MODELE:	0182 -	BOMBA DE CALOR AIRE-AIRE PARTIDA. UNIDAD EXTERIOR VENTILADOR HELICOIDAL. REGULACION microPC SMALL	I COMPRESOR/I CIRCUITO I COMPRESSEUR/I CIRCUIT I COMPRESSOR/I CIRCUIT
MODIFICATION: MODIFICATION:	-			V° B°		NP :	06C018283-01	POMPE A CHALEUR AIR-AIR TYPE SPLIT-SYSTEM. UNITE EXTERIEURE. VENTILATEUR HELICOIDALE. REGULATION microPC SMALL	PAGINA PAGE
SUSTITUYE A: REPLACE: TAKE:	-	SUSTITUIDO POR: REPLACÉ PAR: TAKE BY:	-			NF :	-	AIR TO AIR HEAT PUMP SPLIT-SYSTEM. OUTDOOR UNIT HELICOIDAL FAN. microPC SMALL CONTROL	5/14

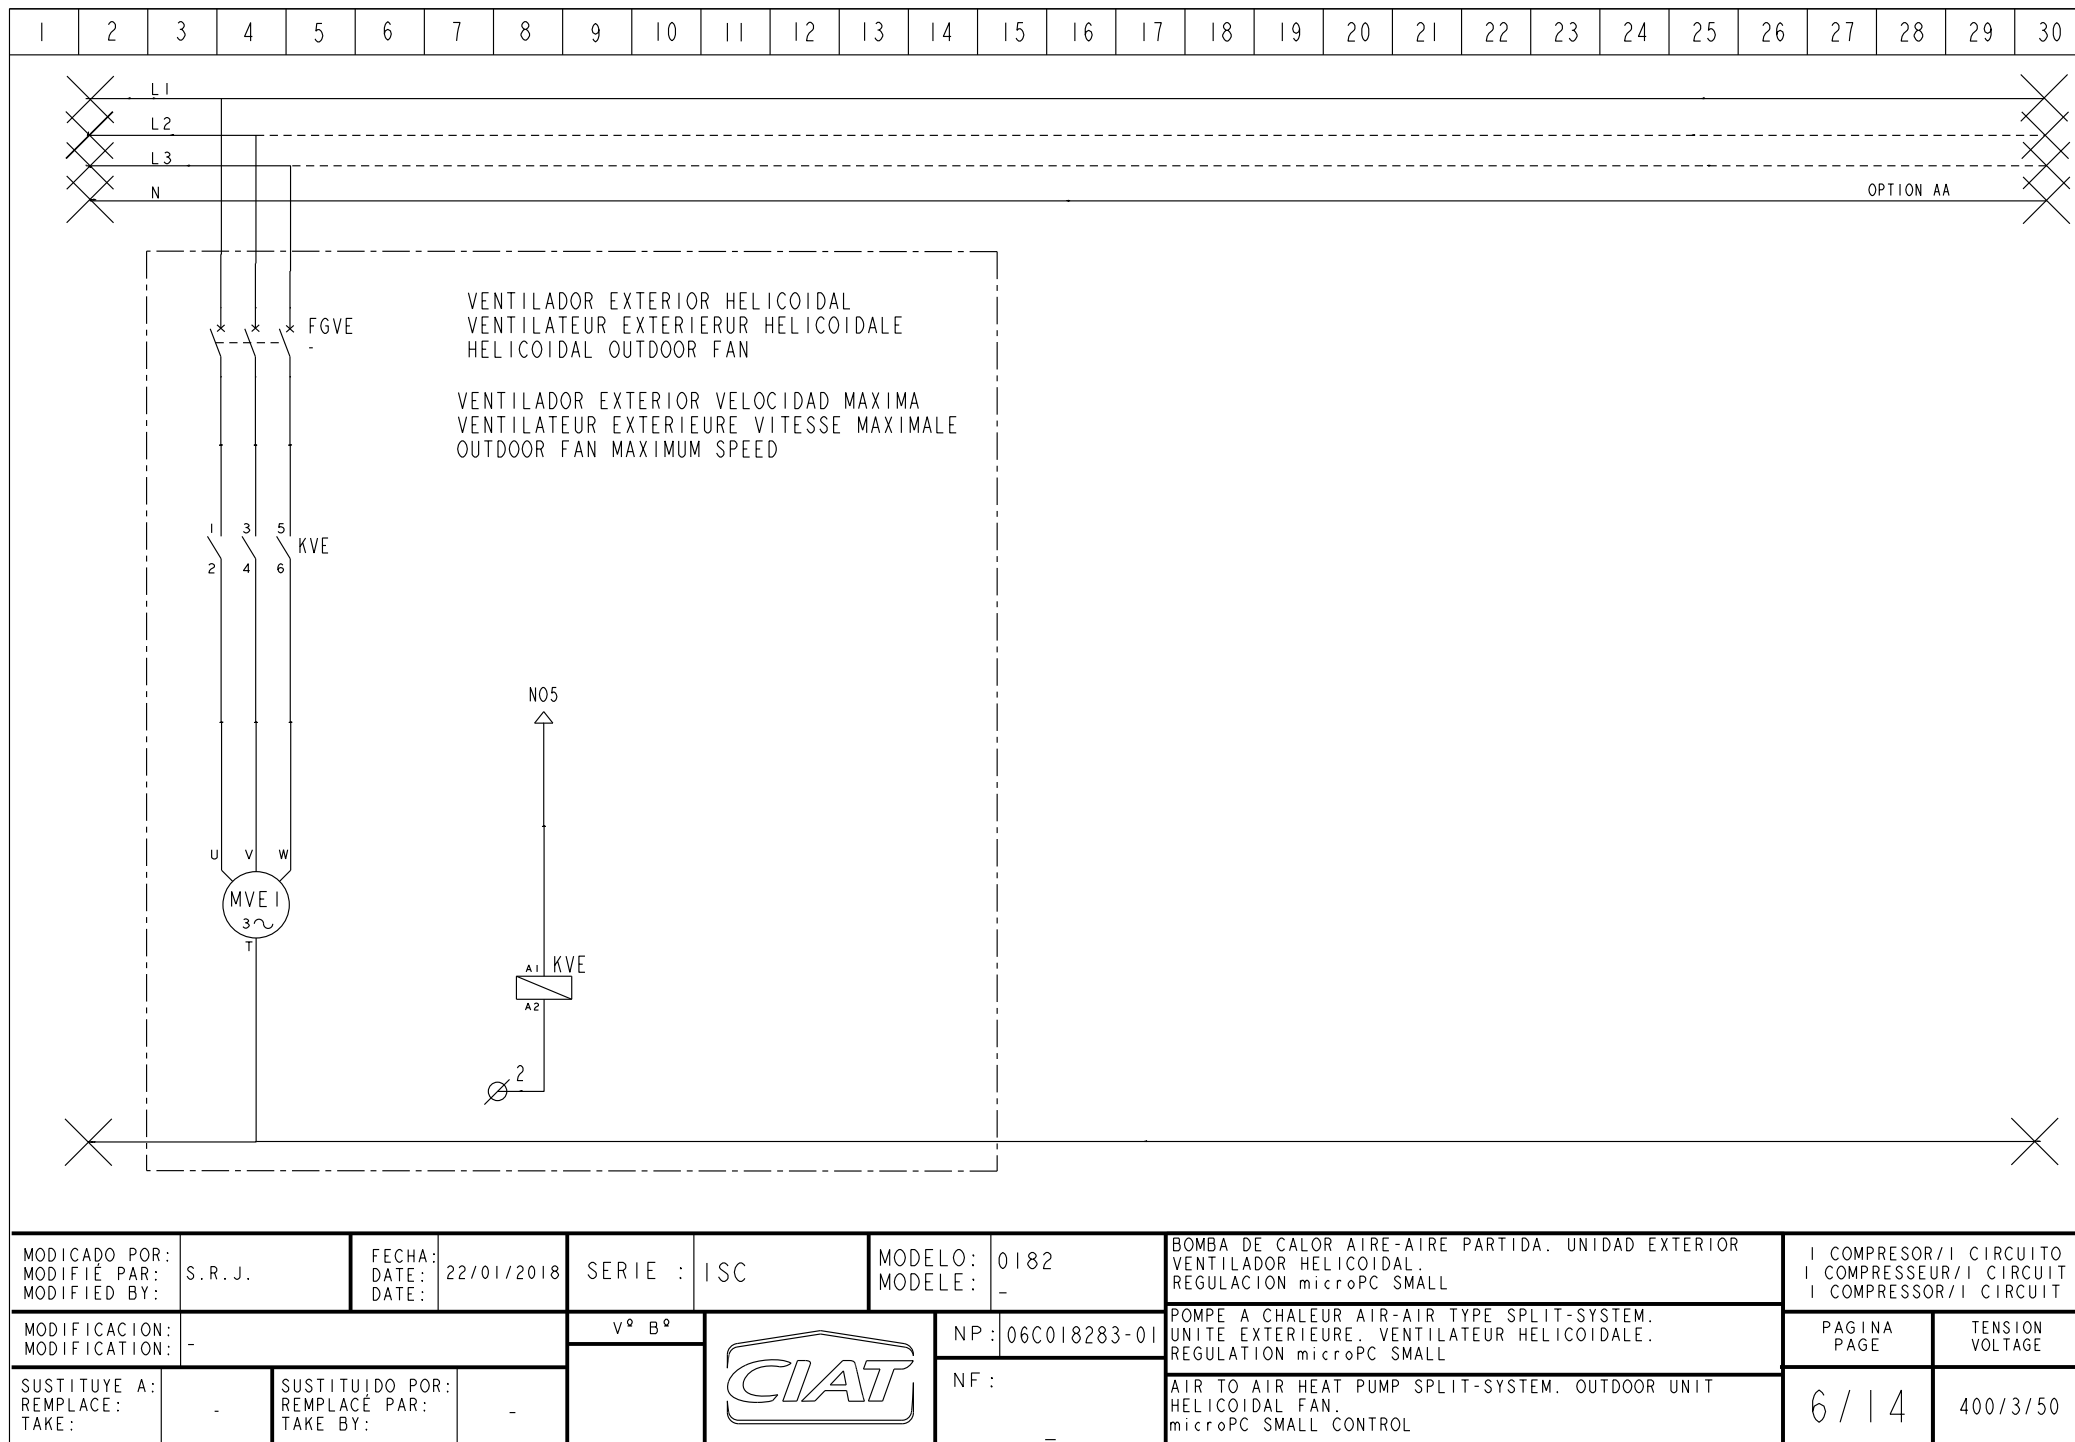


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30
---	---	---	---	---	---	---	---	---	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----

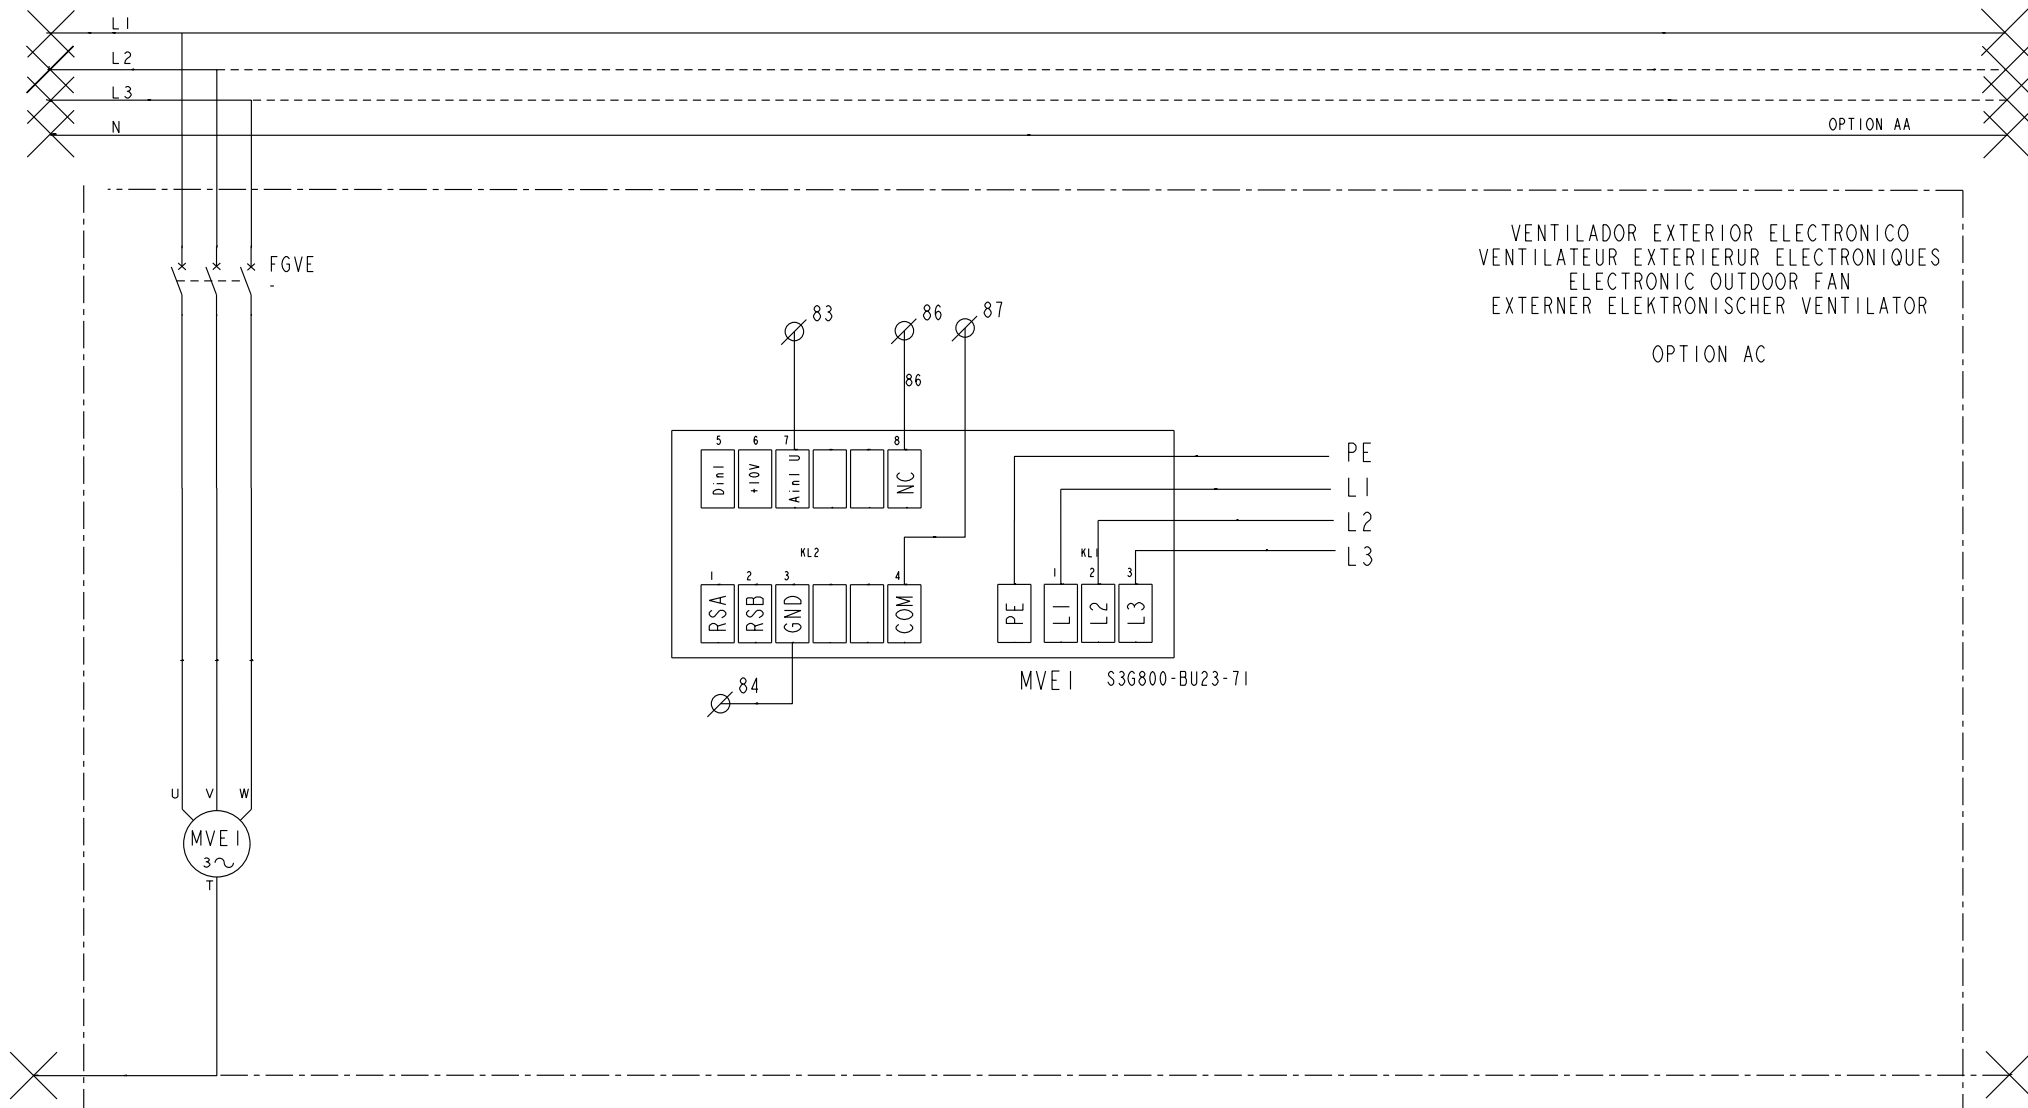

MODIFICADO POR: MODIFIE PAR: MODIFIED BY:	S.R.J.	FECHA: DATE: DATE:	22/01/2018	SERIE :	ISC	MODELO: MODELE:	0182 -	BOMBA DE CALOR AIRE-AIRE PARTIDA. UNIDAD EXTERIOR VENTILADOR HELICOIDAL. REGULACION microPC SMALL	I COMPRESOR/I CIRCUITO I COMPRESSEUR/I CIRCUIT I COMPRESSOR/I CIRCUIT
MODIFICACION: MODIFICATION:	-			V° B°		NP:	06C018283-01	POMPE A CHALEUR AIR-AIR TYPE SPLIT-SYSTEM. UNITE EXTERIEURE. VENTILATEUR HELICOIDALE. REGULATION microPC SMALL	PAGINA PAGE
SUSTITUYE A: REPLACE: TAKE:	-	SUSTITUIDO POR: REPLACÉ PAR: TAKE BY:	-			NF:	-	AIR TO AIR HEAT PUMP SPLIT-SYSTEM. OUTDOOR UNIT HELICOIDAL FAN. microPC SMALL CONTROL	7 / 14





400/3/50

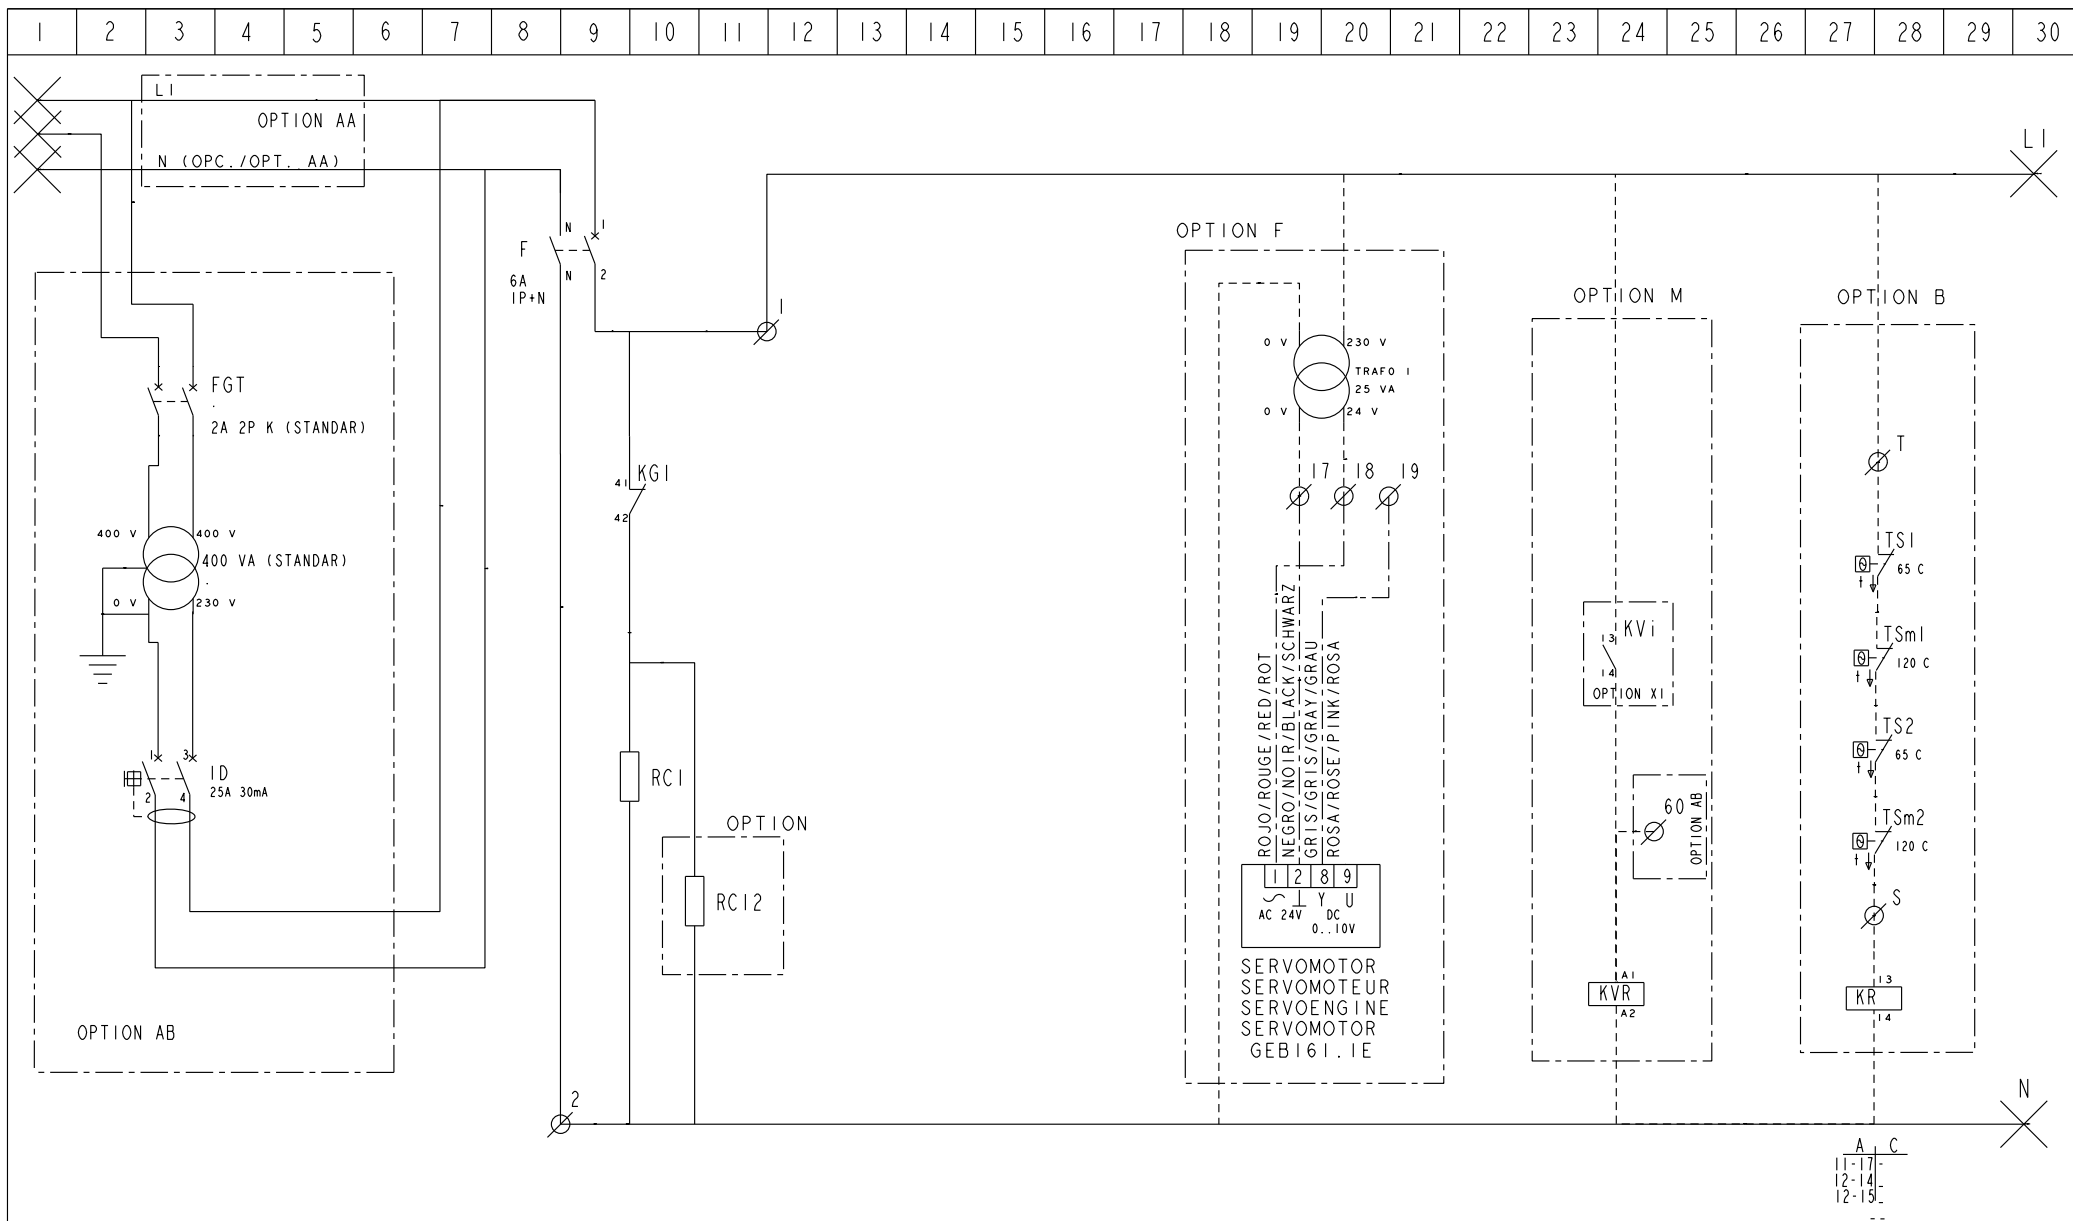



MODIFICADO POR: MODIFIÉ PAR: MODIFIED BY:	S.R.J.	FECHA: DATE: DATE:	22/01/2018	SERIE :	ISC	MODELO: MODELE:	0182 -	BOMBA DE CALOR AIRE-AIRE PARTIDA. UNIDAD EXTERIOR VENTILADOR HELICOIDAL. REGULACION microPC SMALL	I COMPRESOR/I CIRCUITO I COMPRESSEUR/I CIRCUIT I COMPRESSOR/I CIRCUIT
MODIFICATION: MODIFICATION:	-			V° B°		NP:	06C018283-01	POMPE A CHALEUR AIR-AIR TYPE SPLIT-SYSTEM. UNITE EXTERIEURE. VENTILATEUR HELICOIDALE. REGULATION microPC SMALL	PAGINA PAGE
SUSTITUYE A: REPLACE: TAKE:	-	SUSTITUIDO POR: REPLACÉ PAR: TAKE BY:	-			NF:	-	AIR TO AIR HEAT PUMP SPLIT-SYSTEM. OUTDOOR UNIT HELICOIDAL FAN. microPC SMALL CONTROL	9/14
									TENSION VOLTAGE
									400/3/50



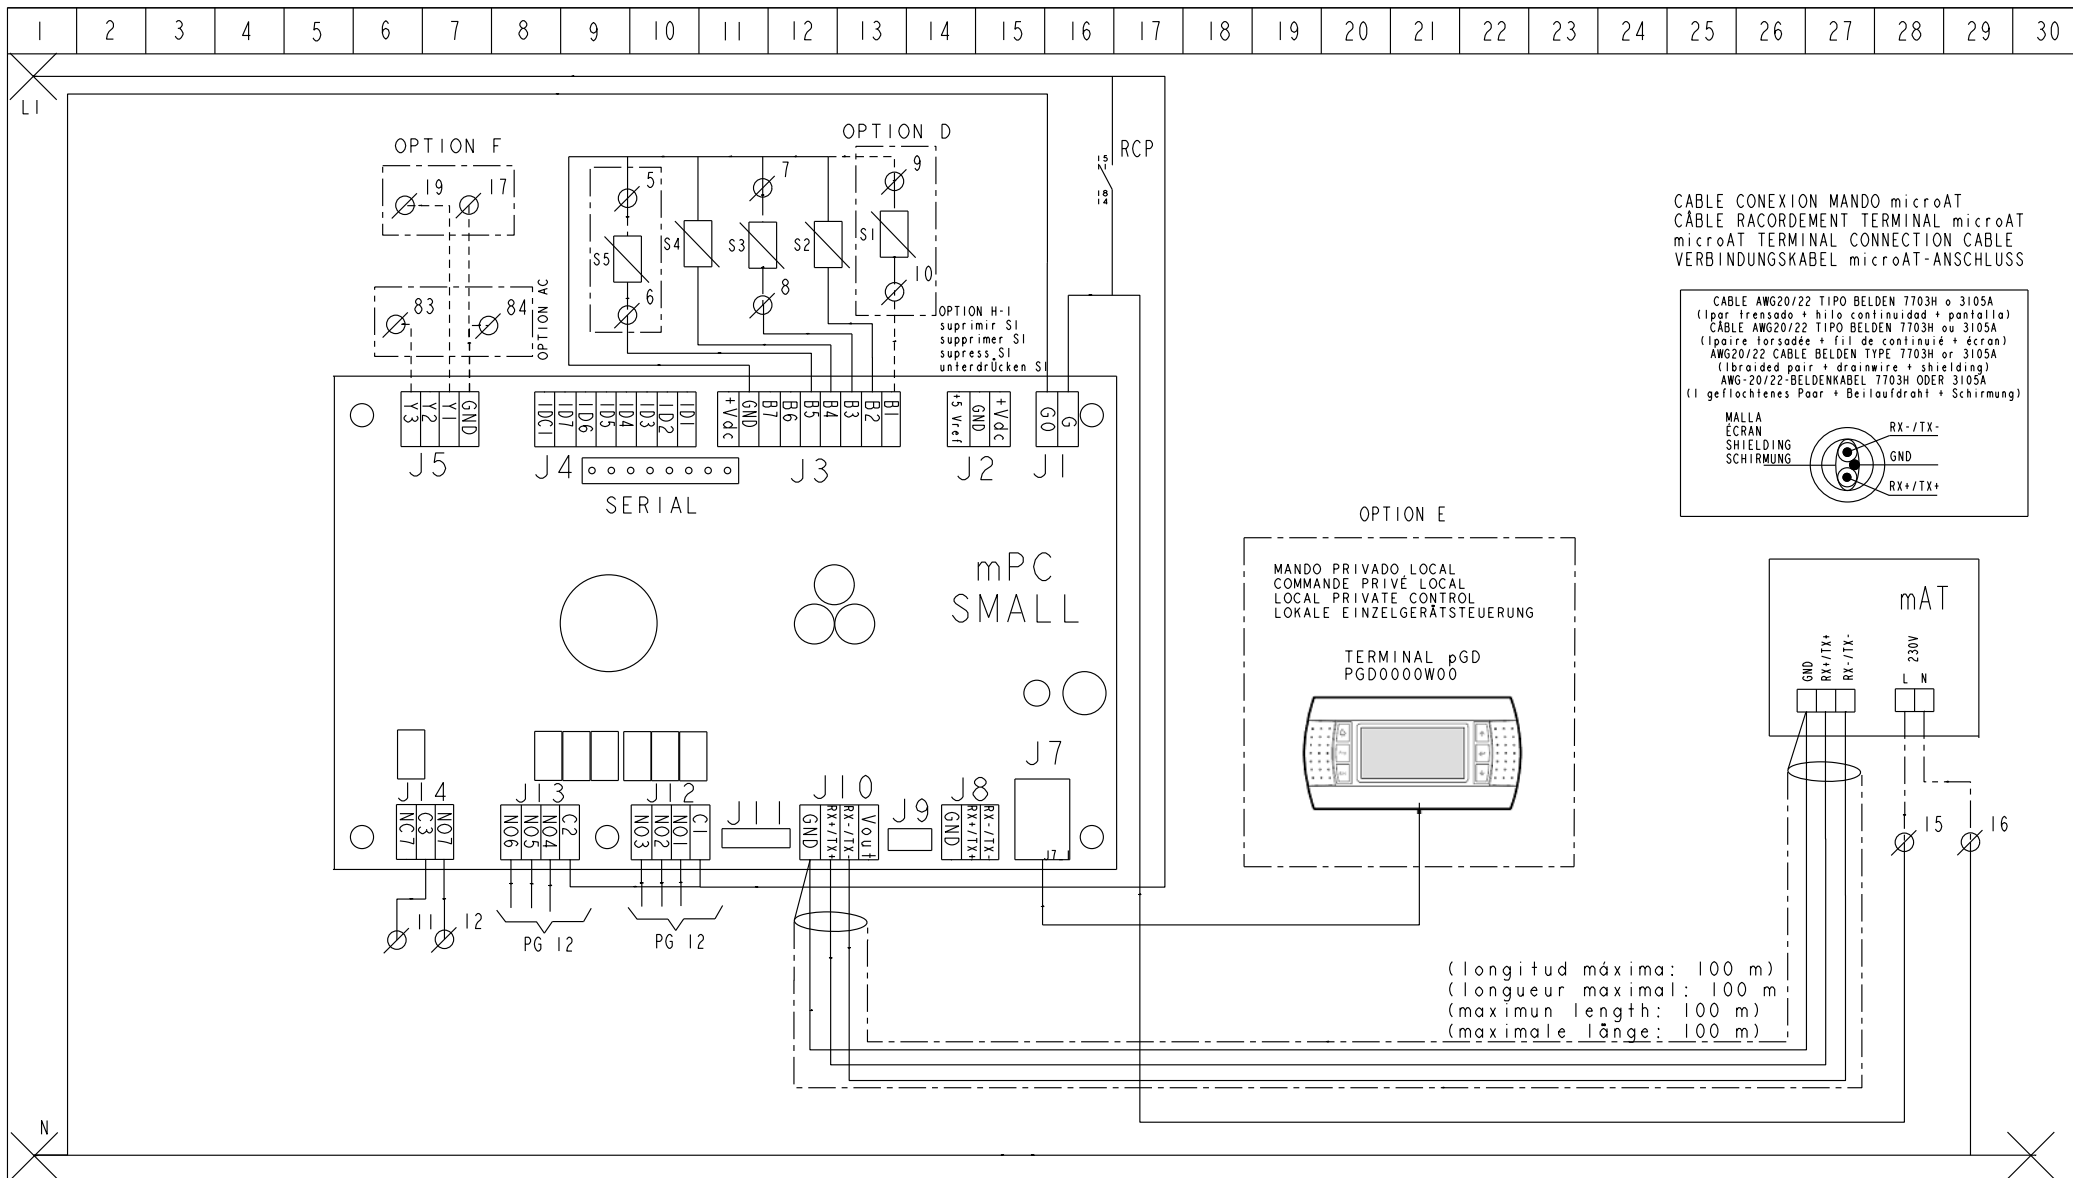

MODIFICADO POR: MODIFIÉ PAR: MODIFIED BY:	S.R.J.	FECHA: DATE: DATE:	22/01/2018	SERIE : ISC	MODELO: MODELE:	0182 -	BOMBA DE CALOR AIRE-AIRE PARTIDA. UNIDAD EXTERIOR VENTILADOR HELICOIDAL. REGULACION microPC SMALL	I COMPRESOR/I CIRCUITO I COMPRESSEUR/I CIRCUIT I COMPRESSOR/I CIRCUIT	
MODIFICACION: MODIFICATION:	-			V° B°		NP : 06C018283-01	POMPE A CHALEUR AIR-AIR TYPE SPLIT-SYSTEM. UNITE EXTERIEURE. VENTILATEUR HELICOIDALE. REGULATION microPC SMALL	PAGINA PAGE	TENSION VOLTAGE
SUSTITUYE A: REPLACE: TAKE:	-	SUSTITUIDO POR: REPLACÉ PAR: TAKE BY:	-	NF :		AIR TO AIR HEAT PUMP SPLIT-SYSTEM. OUTDOOR UNIT HELICOIDAL FAN. microPC SMALL CONTROL	10/14	400/3/50	

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30
---	---	---	---	---	---	---	---	---	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----

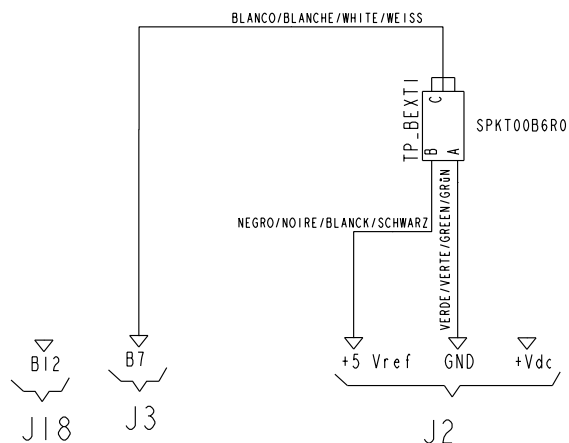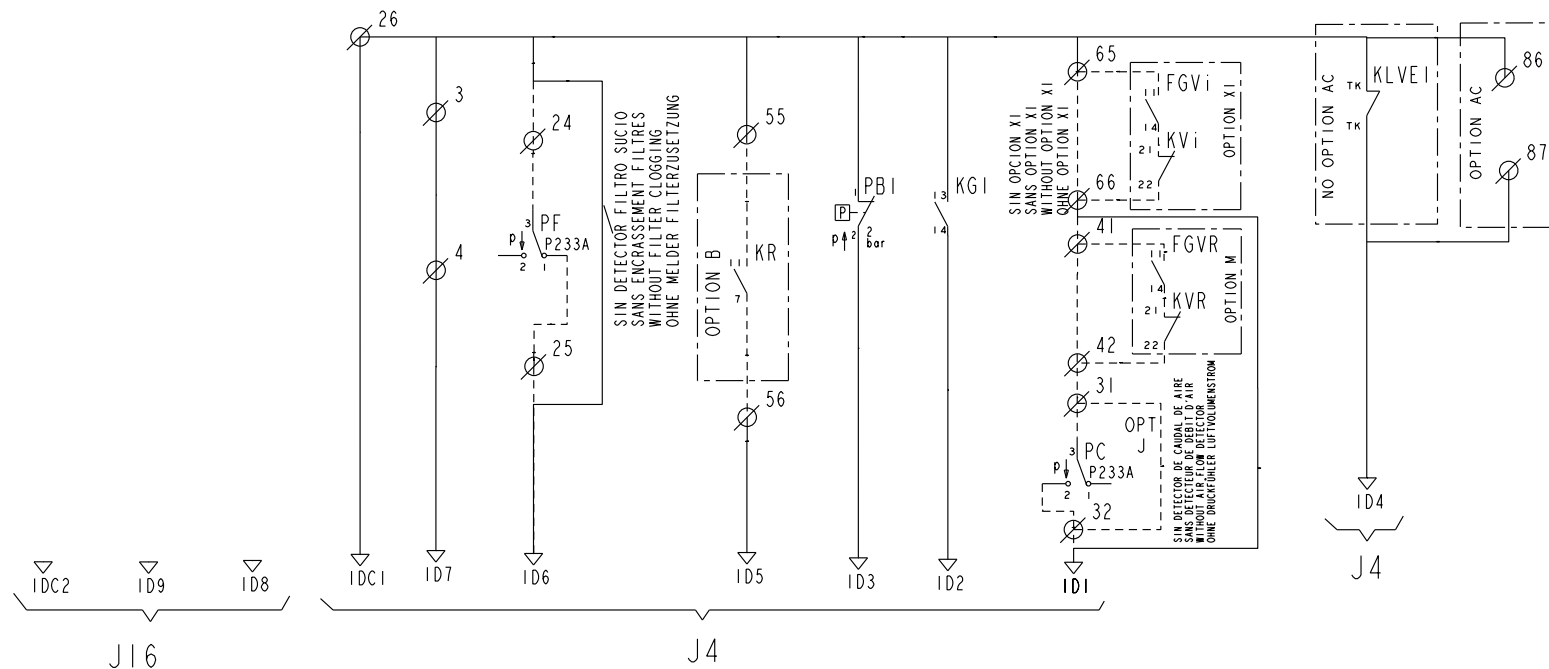


TA :	TERMOSTATO ANTIHIELO	THERMOSTAT ANTIGEL	ANTI FROST THERMOSTAT	FROSTSCHUTZTHERMOSTAT
DH :	DETECTOR DE HUMOS	DETECTEUR DE FUMÉES	SMOKE DETECTOR	RAUCHMELDER
PF :	PRESOSTATO FILTRO	PRESSOSTAT FILTRE ENCRASSÉ	FILTER CLOGGING PRESSOSTAT	DRUCKFÜHLER FILTERZUSETZUNG
PC :	PRESOSTATO CAUDAL DE AIRE	PRESSOSTAT DEBIT D'AIR	AIR FLOW PRESSOSTAT	DRUCKFÜHLER LUFTVOLUMENSTROM

SONDAS / SONDES / SENSORS / FÜHLER

S1	AIRE RETORNO (OPC.D)	AIR DE REPRIS (OPT.D)	RETURN AIR (OPT.D)	RÜCKLUFTFÜHLER (OPT.D)
S2	AIRE EXTERIOR	AIR EXTERIEUR	EXTERNAL AIR	AUßENFÜHLER
S3	AIRE IMPULSION	AIR DE SOUFFLAGE	DISCHARGE AIR	ABLUF
S4	SONDA DESCARGA CI	SONDE REFOULEMENT CI	DISCHARGE SENSOR CI	ABFLUSSFÜHLER CI
S5	AIRE DE MEZCLA (OPC. F)	AIR DE MÉLANGE (OPT. F)	AIR MIXING (OPT. F)	MISCHLUFT (OPT. F)
S6				
S7				
S8				
S9	AIRE TEMP. AMBIENTE NTC (OPC.H)	AIR TEMP. D'AMBIANCE NTC (OPC.H)	AMBIENT TEMP.AIR NTC (OPC.H)	RAUMLUFTTEMPERATUR NTC (OPC.H)
S10				


MODIFICADO POR: MODIFIÉ PAR: MODIFIED BY:	S.R.J.	FECHA: DATE: DATE:	22/01/2018	SERIE :	ISC	MODELO: MODELE:	0182 -	BOMBA DE CALOR AIRE-AIRE PARTIDA. UNIDAD EXTERIOR VENTILADOR HELICOIDAL. REGULACION microPC SMALL	I COMPRESOR/I CIRCUITO I COMPRESSEUR/I CIRCUIT I COMPRESSOR/I CIRCUIT
MODIFICATION: MODIFICATION:	-			V° B°		NP:	06C018283-01	POMPE A CHALEUR AIR-AIR TYPE SPLIT-SYSTEM. UNITE EXTERIEURE. VENTILATEUR HELICOIDALE. REGULATION microPC SMALL	PAGINA PAGE
SUSTITUYE A: REPLACE: TAKE:	-	SUSTITUIDO POR: REPLACÉ PAR: TAKE BY:	-			NF:	-	AIR TO AIR HEAT PUMP SPLIT-SYSTEM. OUTDOOR UNIT HELICOIDAL FAN. microPC SMALL CONTROL	11/14 400/3/50



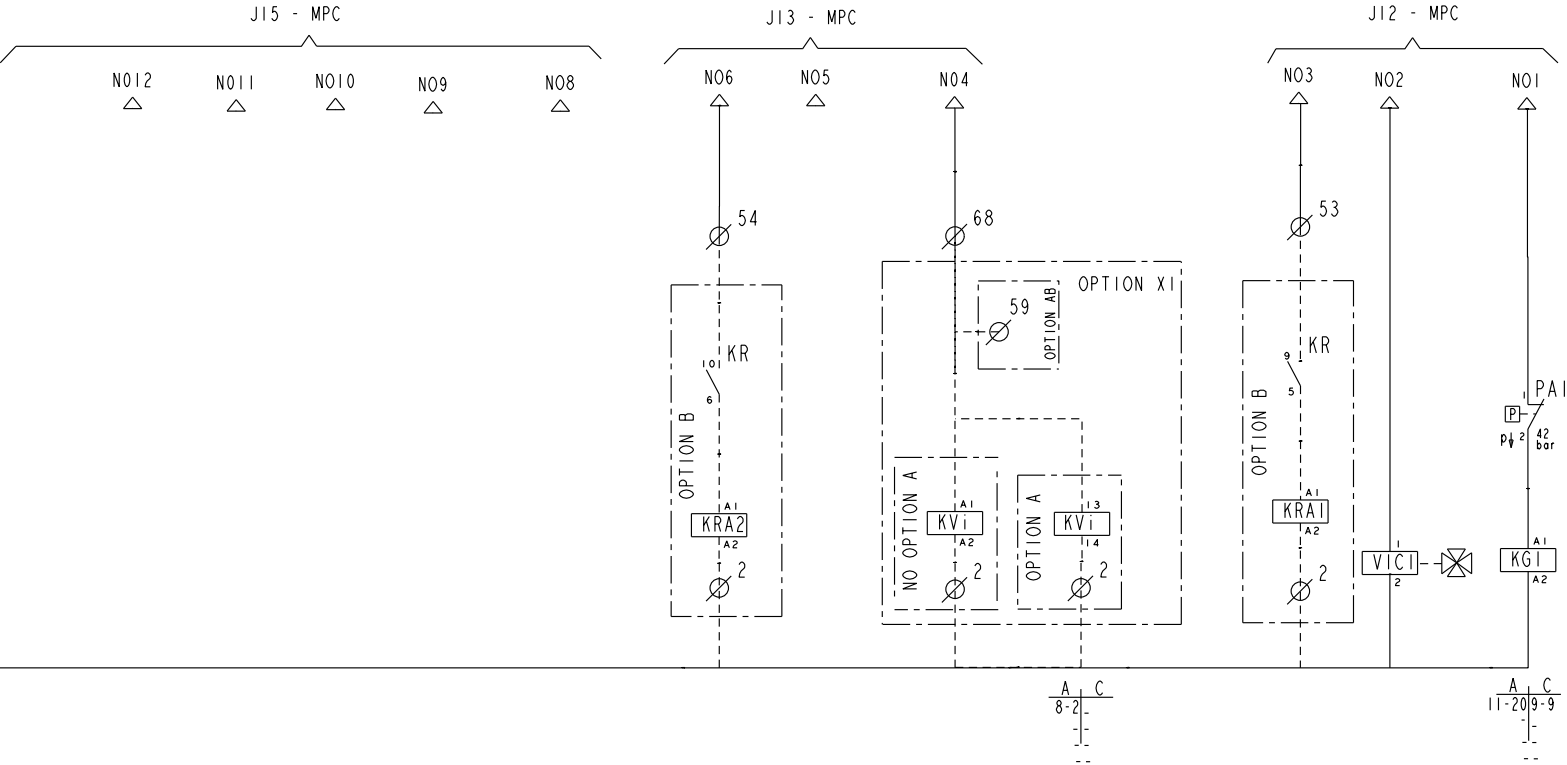


MODICADO POR: MODIFIÉ PAR: MODIFIED BY:	S.R.J.	FECHA: DATE: DATE:	22/01/2018	SERIE :	ISC	MODELO: MODELE:	0182 -	BOMBA DE CALOR AIRE-AIRE PARTIDA. UNIDAD EXTERIOR VENTILADOR HELICOIDAL. REGULACION microPC SMALL	I COMPRESOR/I CIRCUITO I COMPRESSEUR/I CIRCUIT I COMPRESSOR/I CIRCUIT
MODIFICACION: MODIFICATION:	-			V° B°		NP :	06C018283-01	POMPE A CHALEUR AIR-AIR TYPE SPLIT-SYSTEM. UNITE EXTERIEURE. VENTILATEUR HELICOIDALE. REGULATION microPC SMALL	PAGINA PAGE
SUSTITUYE A: REPLACE: TAKE:	-	SUSTITUIDO POR: REPLACÉ PAR: TAKE BY:	-			NF :	-	AIR TO AIR HEAT PUMP SPLIT-SYSTEM. OUTDOOR UNIT HELICOIDAL FAN. microPC SMALL CONTROL	12/14
									TENSION VOLTAGE 400/3/50

OPTION H

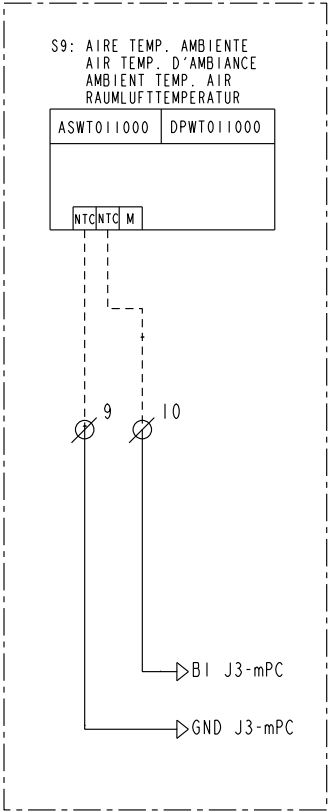


MODIFICADO POR: MODIFIÉ PAR: MODIFIED BY:	S.R.J.	FECHA: DATE: DATE:	22/01/2018	SERIE :	ISC	MODELO: MODELE:	0182 -	BOMBA DE CALOR AIRE-AIRE PARTIDA. UNIDAD EXTERIOR VENTILADOR HELICOIDAL. REGULACION microPC SMALL	I COMPRESOR/I CIRCUITO I COMPRESSEUR/I CIRCUIT I COMPRESSOR/I CIRCUIT		
MODIFICACION: MODIFICATION:	-			Vº Bº			NP:	06C018283-01	POMPE A CHALEUR AIR-AIR TYPE SPLIT-SYSTEM. UNITE EXTERIEURE. VENTILATEUR HELICOIDALE. REGULATION microPC SMALL	PAGINA PAGE	TENSION VOLTAGE
SUSTITUYE A: REPLACE: TAKE:	-	SUSTITUIDO POR: REPLACÉ PAR: TAKE BY:	-				NF:		AIR TO AIR HEAT PUMP SPLIT-SYSTEM. OUTDOOR UNIT HELICOIDAL FAN. microPC SMALL CONTROL	13/14	400/3/50


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30
---	---	---	---	---	---	---	---	---	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----

IMPLANTACION DE PLETINA
IMPLANTATION DE PLATINE
ELECTRICAL PANEL LOCATION
POSITION DER SCHALTТАFEL


OPTION XI+ M

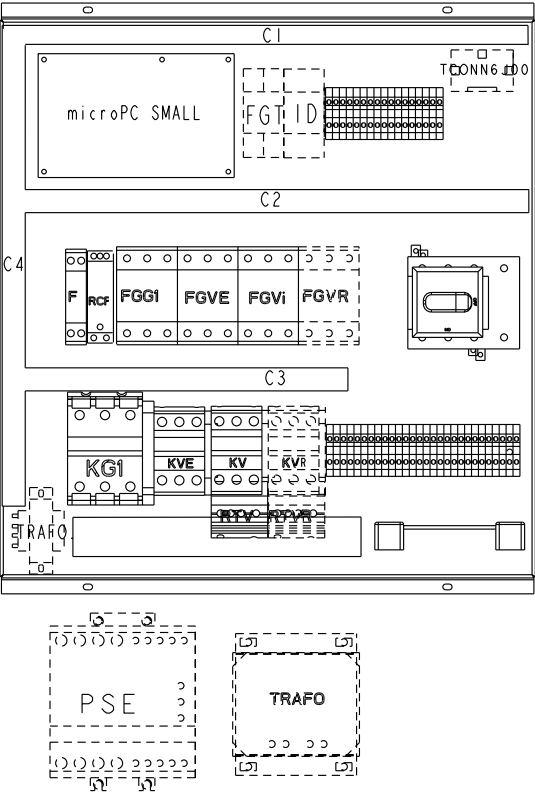

OPTION XI+ B

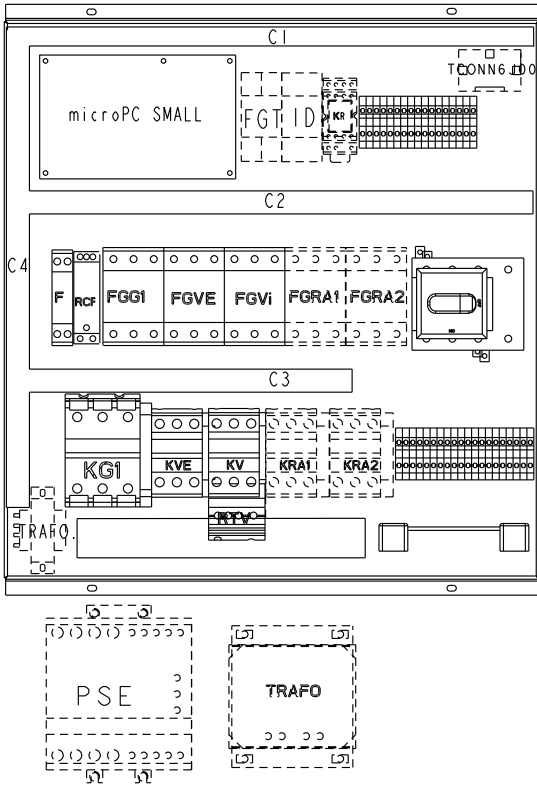

OPTION XI+ AC

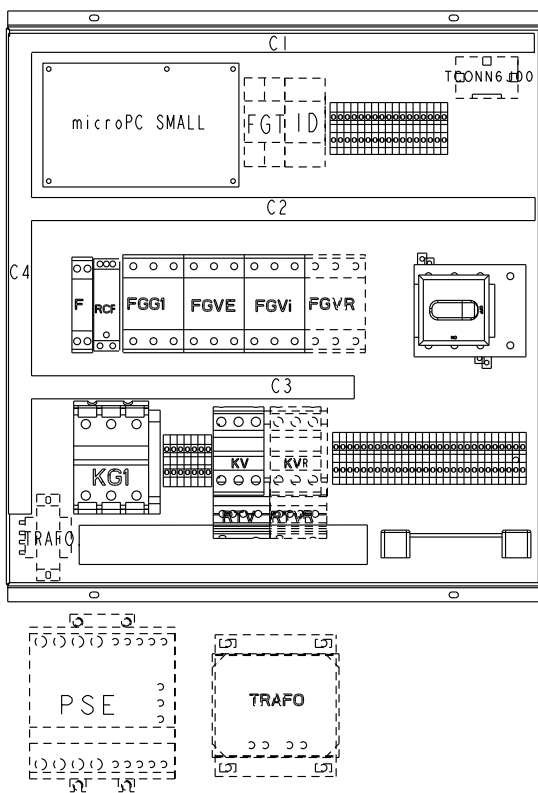

C1 = 460 mm
C2 = 440 mm
C3 = 330 mm
C4 = 420 mm

MODICADO POR: MODIFIE PAR: MODIFIED BY:	S.R.J.	FECHA: DATE: DATE:	22/01/2018	SERIE :	ISC	MODELO: MODELE:	0182 -	BOMBA DE CALOR AIRE-AIRE PARTIDA. UNIDAD EXTERIOR VENTILADOR HELICOIDAL. REGULACION microPC SMALL	I COMPRESOR/I CIRCUITO I COMPRESSEUR/I CIRCUIT I COMPRESSOR/I CIRCUIT
MODIFICATION: MODIFICATION:	-			V° B°		NP:	06C018283-01	POMPE A CHALEUR AIR-AIR TYPE SPLIT-SYSTEM. UNITE EXTERIEURE. VENTILATEUR HELICOIDALE. REGULATION microPC SMALL	PAGINA PAGE
SUSTITUYE A: REPLACE: TAKE:	-	SUSTITUIDO POR: REPLACÉ PAR: TAKE BY:	-			NF:	-	AIR TO AIR HEAT PUMP SPLIT-SYSTEM. OUTDOOR UNIT HELICOIDAL FAN. microPC SMALL CONTROL	14/14 400/3/50